

FD#4

LBM Engineering, LLC11 Hally Lane, Colchester, CT 06415-2133 Phone 860-416-9809 Email John@LBMEngineering.com

CIVIL ENGINEERING - LAND DEVELOPMENT - SITE PLANS - STORMWATER MANAGEMENT

RECEIVED**Engineering Report**

JUN 23 2026

June 18, 2026

For Land Use Commissions Submittals**Kineo Estates Conservation Subdivision,
Ledyard, Connecticut****Land Use Department**

EXISTING CONDITIONS: Reference is made to the following Plan Set: "Plan Showing Kineo Estates Conservation Subdivision Prepared for Mt. Kineo Builders 12 Hyde Park Drive and 975 Long Cove Road, Ledyard, Connecticut" Scales as Shown March 2026, By Dieter & Gardner, Gales Ferry, CT. The property is located on the east side of Long Cove Road south of Hyde Park Drive. The property is wooded and drains to the south.

METHODOLOGY: The Rational Method was used for analyzing runoff rates per Part III of the Town of Ledyard's *Ordinance Regulating the Management of Stormwater Runoff*. The descending leg of the hydrographs are increased by a factor of 2.5 to provide additional stormwater volume. Gutter Flow Analysis and Storm System design are designed for a 25-year storm event. Intensity-Duration-Frequency (IDF) Curves were downloaded from the NOAA Atlas 14 web site.

STORMWATER MANAGEMENT: The proposed development will not change the existing drainage patterns. Pavement runoff from the proposed road, Ellie Rose Lane, will drain to three (3) water quality/detention basins. Each basin has outlet piping designed to reduce the peak rate of runoff from the pavement to a rate of undeveloped ground cover. The basins' outlets are extended detention under drains that hold the runoff for less than 12 hours and settle out suspended solids and drain empty after each storm. Discharge rate from the detention/water quality basin will be further reduced as it flows over 1,000 feet through wetlands and underbrush. The following table provides a comparison of computed peak rates of runoff from roadway pavement for undeveloped land versus the developed condition:

BASIN	AREA (ACRES)	RUNOFF COEFF. (O'LAND)	PRE-DEVELOPED PEAK RUNOFF RAINFALL INTENSITY (IN./HR.)			
			2-YR 3.46 IN./HR.	10 YR 5.14 IN./HR.	25 YR 6.18 IN./HR.	100-YR 7.80 IN./HR.
CB1	0.20	0.25	0.17 CFS	0.26 CFS	0.31 CFS	0.39 CFS
CB3	0.46	0.25	0.40 CFS	0.59 CFS	0.71 CFS	0.90 CFS
CB5	0.35	0.25	0.30 CFS	0.45 CFS	0.54 CFS	0.68 CFS

BASIN	PEAK OUTLET FLOW FROM BASINS			
	2-YR	10 YR	25 YR	100-YR
CB1	0.21 CFS +0.04	0.25 CFS -0.01	0.27 CFS -0.04	0.30 CFS -0.09
CB3	0.43 CFS +0.03	0.51 CFS -0.08	0.56 CFS -0.15	0.61 CFS -0.29
CB5	0.37 CFS +0.07	0.45 CFS -0.00	0.49 CFS -0.05	0.55 CFS -0.13

There is a slight computed increase (less than 0.10 CFS) in peak flow rate for the 2-year storm.

LBM Engineering, LLC


11 Hally Lane, Colchester, CT 06415-2133 Phone 860-416-9809 Email John@LBMEngineering.com

CIVIL ENGINEERING - LAND DEVELOPMENT - SITE PLANS - STORMWATER MANAGEMENT
Kineo Estates Page 2

There is a proposed cross-culvert that will carry an intermittent watercourse under Ellie Rose Lane. The drainage areas were delineated, and the 50-year peak flows were determined using USGS StreamStats (www.usgs.gov). The proposed 36-inch culvert was sized by verifying the inlet control headwater was no more than 1.5 times the pipe diameter. (HW/D). Calculations are attached to this report.

CONCLUSION: The proposed development will not have adverse effects on down-gradient properties and is in keeping with the policies and goals of the Ledyard Planning and Zoning Commission.

Submitted by:
LBM Engineering, LLC

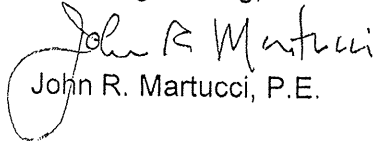
John R. Martucci, P.E.

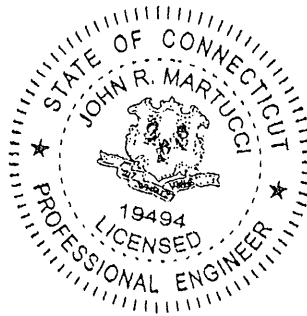


TABLE OF CONTENTS

<u>Title</u>	<u>Page</u>
Report	1 – 2
Drainage Areas	3 – 4
Gutter Flow Analysis	5
System Design	6
NOAA Precipitation	7 – 8
36" Cross Culvert	9 – 16
15" & 36" Pipe Flow Charts	17 – 18
Preformed Scour Holes for 36" Culvert	19 – 21
Detention / Water Quality Basins	22 – 37
Drainage Area Maps	38 - 40

PREPARED BY JRM	DATE PREPARED 11/2024	LBM Engineering, LLC 11 HALLY LANE COLCHESTER, CONNECTICUT 06415 TEL: (860)-416-9809 EMAIL: JOHN@LBMENGINEERING.COM	JOB NUMBER	PAGE NUMBER
CHECKED BY	DATE CHECKED REV 4/2024		CLIENT NAME	TOTAL PAGES

CONSERVATION SUBDIVISION - KINED SUBDIVISION / LEDYARD

RATIONAL METHOD NOTE: RATIONAL METHOD WAS USED TO COMPUTE PEAK RATES OF RUNOFF, DRAINAGE AREAS ARE SMALL (<1 ACRE)

$$Q_{25} = C \times I \times A \quad \begin{array}{l} C_{PAVEMENT} = 0.95 \\ C_{OVERLAND} = 0.25 \end{array}$$

$$T_C = 10 \text{ MINUTES} \quad I = 5.5 \text{ INCHES/HOUR}$$

ELLIE ROSE LN
CB 1 STA. 12+75, RT

$$275' \times 14' = 0.09 \text{ AC} \quad \text{PAVEMENT } C = 0.95$$

$$AC = 0.95 \times 0.09 = 0.09$$

$$Q_{25} = 0.09 \times 5.5 = 0.50 \text{ CFS}$$

CB 2 STA 12+75, LT (MIRROR IMAGE OF CB1)

ELLIE ROSE LN
CB 3 STA 16+97, RT (LOW POINT)

$$14+42 \text{ TO } 18+66 = 424' \times 14' = 0.14 \text{ AC} \quad \text{PAVT} \times 0.95 = 0.133$$

$$15+0 \text{ TO } 16+00 \text{ RT} = 1800 \text{ SF} = 0.04 \text{ AC (overland)} \times 0.25 = 0.010$$

$$\text{TOTAL AREA } 0.18 \quad \text{WEIGHTED } C \quad 0.143 / 0.18 = 0.79$$

CB 4 STA 16+97 LT (MIRROR IMAGE OF CB3)

PREPARED BY JEM	DATE PREPARED 4/2026	LBM Engineering, LLC 11 HALLY LANE COLCHESTER, CONNECTICUT 06415 TEL: (860)-416-9809 EMAIL: JOHN@LBMENGINEERING.COM	JOB NUMBER	PAGE NUMBER
CHECKED BY	DATE CHECKED		CLIENT NAME	TOTAL PAGES

CB 5 STA. 20+52 ELLIE ROSE LN

			A x C
10,442 SF PAVEMENT	0.24 ACRES	x 0.95	= 0.228
4774 SF O'LAND	0.11 AC	x 0.25	= 0.028
	<u>0.35 AC</u>		<u>0.256</u>

WEIGHTED C = $0.256 / 0.35 = 0.73$

CB 1A STA 14+42, RT ELLIE ROSE LN

(167' x 14') = 0.05 AC		AC
	x (PAV'T) 0.95	= 0.048

CB 1B STA 14+42, LT

MIRROR OF 1A

PROJECT: KINEO ESTATES SUBDIVISION
PROJECT NO.:
TOWN: Ledyard
ROAD: ELLIE ROSE LN
LOCATION: N/A

DESIGNED BY: JRM DATE: 01/03/25
CHECKED BY: REV:
DATE:

GUTTER FLOW ANALYSIS - 25 YR STORM																
Inlet ID	Inlet Station and Offset	Area in Acres (A)	Runoff Coeff. (C)	Time to Inlet (min.)	Rainfall Intensity (in/hr)	AC	Total AC	Q to Inlet (cfs)	Grade of Gutter ft/ft (SL)	Cross Slope Of Shoulder ft/ft (Sx)	Depth of Flow of Gutter (ft)	Gutter Flow Width (ft)	Q Bypassing Inlet (cfs)	AC Bypassing Inlet	AC Entering Catch Basin	Inlet Type
ELLIE ROSE LN RIGHT GUTTER																
C8 1	12+75, RT	0.090	0.95	10	5.50	0.086	0.086	0.517	0.010	0.043	0.139	3.240	0.027	0.005	0.081	"C"
C8 1A	14+42, RT	0.050	0.95	10	5.50	0.048	0.052	0.317	0.010	0.043	0.116	2.697	0.002	0.000	0.048	"C"
C8 3	16+97, RT	0.180	0.79	10	5.50	0.142	0.143	0.862	LOW PT	0.043	SEE LOW POINT ANALYSIS				0.142	"C"
ELLIE ROSE LN LEFT GUTTER																
C8 2	12+75, LT	0.090	0.95	10	5.50	0.086	0.086	0.517	0.010	0.043	0.139	3.240	0.027	0.005	0.081	"C"
C8 2A	14+42, LT	0.050	0.95	10	5.50	0.048	0.052	0.317	0.010	0.043	0.116	2.697	0.002	0.000	0.048	"C"
C8 4	16+97, LT	0.180	0.79	10	5.50	0.142	0.143	0.862	LOW PT	0.043	SEE LOW POINT ANALYSIS				0.142	"C"
C8 5	20+52, RT	0.350	0.73	10	5.50	0.256	0.256	1.546	LOW PT	0.043	SEE LOW POINT ANALYSIS				0.256	"C"
											NOTES:					
LOW POINT ANALYSIS																
INLET	Q TO INLET	PERIM.	C WEIR	d WEIR	WIDTH OF FLOW	d ORIFICE										
C3 3	0.862	5.020	3	0.148	2.97	0.010	<0.4' DEEP - OK									
C3 4	0.862	5.020	3	0.148	2.97	0.010	<0.4' DEEP - OK									
C3 5	1.546	5.020	3	0.219	4.38	0.008	<0.4' DEEP - OK									

Notes:

- 1.) Manning's n = 0.016 (asphalt).
- 2.) Tc = 5 minutes minimum for areas with all pavement.
- 3.) Tc = 10 minutes minimum for small areas with pavement and grass.
- 4.) All low points operate as a weir. Depth (d) over grate is less than 0.4 feet.

GRATES	PERIM	AREA
C	5.02	3.13
C DOUB	7.33	6.26
CL	7.33	3.13
CL DOUB	11.96	6.26

STORM SEWER SYSTEM DESIGN

Client: KINEO ESTATES SUBDIVISION
 Project: ELLIE ROSE LANE
 Road: 25-YR
 Return Period for Design: 25-YR
 Prepared By: JRM Date: 01/03/25 Revised: 1
 Sheet No. 1 of 1

Line Segment		Time to Inlet (min.)	Time in Pipe (min.)	Accumul. Time (min.)	A x C Entering System	Sum of A x C in System	Rainfall Intensity, R (in./hr.)	Q in System (c.f.s.)	Size (in.)	Length (ft.)	Slope (ft./ft.)	Pipe Data			Manning "n"
From	To											Avg. Vel. (f.p.s.)	Full Cap. (c.f.s.)	Headwater (ft.)	
CB 2 12+73,LT	CB 1 12+75,RT	10	0.10	10.0	0.081	0.081	5.5	0.45	15	24	0.010	4.0	6.99	0.20	0.012
CB 1 12+75,RT	BASIN	10	0.41	10.1	0.081	0.162	5.5	0.89	15	124	0.014	5.0	8.28	0.30	0.012
CB 2A 14+42,LT	CB 1A 14+42,RT	10	0.13	10.0	0.048	0.048	5.5	0.26	15	24	0.010	3.0	6.99	0.20	0.012
CB 1A 14+42,RT	CB 3 16+97,RT	10	1.07	10.1	0.048	0.096	5.5	0.53	15	256	0.010	4.0	6.99	0.20	0.012
CB 4 16+97,LT	CB 3 16+97,RT	10	0.08	10.0	0.142	0.142	5.5	0.78	15	24	0.010	5.0	6.99	0.30	0.012
CB 3 16+97,RT	BASIN	10	0.08	10.1	0.142	0.38	5.5	2.09	15	45	0.067	10.0	18.10	0.40	0.012
CB 5 20+55,RT	BASIN	10	0.47	10.0	0.256	0.256	5.5	1.41	15	140	0.010	5.0	6.99	0.40	0.012

Manning's "n" for HDPE and RC pipe = 0.012

NOTE: ALL PIPES ARE BELOW FULL CAPACITY.

NOAA ATLAS 14 POINT PRECIPITATION FREQUENCY ESTIMATES: CT

Data description

Data type: Precipitation depth Units: English Time series type: Partial duration 

Select location

1) Manually:

a) By location (decimal degrees, use " " for S and W): Latitude: Longitude:

b) By station (list of CT stations): Select station

c) By address	Search	
---------------	--------	---

e) Use map:

1. *Chlorophyll a* (Chl *a*)

Miscellaneous

1550

2550

DISCUSSION

Contact Us

100

100

10

Source: ESRI Maps

5km
4mi

Source: USGS

POINT PRECIPITATION FREQUENCY (PF) ESTIMATES

WITH 90% CONFIDENCE INTERVALS AND SUPPLEMENTARY INFORMATION
NOAA Atlas 14, Volume 10, Version 3

PF tabular

PF graphical

Supplementary information

Print page

PDS-based precipitation frequency estimates with 90% confidence intervals (in inches)¹

Duration	Average recurrence interval (years)									
	1	2	5	10	25	50	100	200	500	1000
5-min	0.341 (0.265-0.434)	0.407 (0.316-0.519)	0.515 (0.398-0.657)	0.605 (0.466-0.776)	0.729 (0.544-0.964)	0.822 (0.604-1.10)	0.919 (0.654-1.27)	1.03 (0.693-1.44)	1.19 (0.771-1.70)	1.32 (0.836-1.92)
10-min	0.483 (0.376-0.615)	0.577 (0.448-0.735)	0.731 (0.565-0.934)	0.858 (0.660-1.10)	1.03 (0.770-1.37)	1.16 (0.852-1.56)	1.30 (0.926-1.80)	1.46 (0.982-2.04)	1.69 (1.09-2.41)	1.87 (1.18-2.71)
15-min	0.569 (0.442-0.724)	0.679 (0.527-0.865)	0.859 (0.665-1.10)	1.01 (0.777-1.29)	1.22 (0.906-1.61)	1.37 (1.00-1.84)	1.53 (1.09-2.12)	1.72 (1.16-2.39)	1.98 (1.28-2.83)	2.20 (1.39-3.19)
30-min	0.805 (0.626-1.02)	0.960 (0.746-1.22)	1.21 (0.939-1.55)	1.42 (1.10-1.82)	1.71 (1.28-2.27)	1.93 (1.41-2.59)	2.16 (1.54-2.98)	2.42 (1.63-3.37)	2.80 (1.81-3.99)	3.10 (1.96-4.50)
60-min	1.04 (0.810-1.33)	1.24 (0.965-1.58)	1.57 (1.21-2.00)	1.84 (1.42-2.36)	2.21 (1.65-2.92)	2.49 (1.82-3.34)	2.78 (1.98-3.85)	3.12 (2.10-4.35)	3.61 (2.34-5.15)	4.01 (2.54-5.81)
2-hr	1.37 (1.07-1.73)	1.63 (1.28-2.06)	2.06 (1.61-2.60)	2.41 (1.87-3.06)	2.90 (2.18-3.80)	3.27 (2.41-4.35)	3.66 (2.62-5.00)	4.10 (2.77-5.66)	4.74 (3.08-6.71)	5.26 (3.35-7.57)
3-hr	1.59 (1.25-1.99)	1.89 (1.49-2.37)	2.38 (1.87-3.00)	2.79 (2.18-3.53)	3.36 (2.54-4.38)	3.78 (2.80-5.01)	4.23 (3.04-5.76)	4.74 (3.22-6.52)	5.48 (3.58-7.73)	6.09 (3.88-8.72)
6-hr	2.01 (1.60-2.50)	2.39 (1.90-2.97)	3.01 (2.38-3.75)	3.52 (2.77-4.40)	4.22 (3.22-5.46)	4.75 (3.55-6.24)	5.31 (3.85-7.17)	5.95 (4.07-8.12)	6.87 (4.52-9.62)	7.64 (4.90-10.8)
12-hr	2.48 (2.00-3.05)	2.94 (2.36-3.62)	3.69 (2.96-4.56)	4.32 (3.44-5.35)	5.18 (3.98-6.63)	5.82 (4.38-7.57)	6.50 (4.74-8.70)	7.28 (5.01-9.85)	8.41 (5.56-11.7)	9.35 (6.02-13.2)
24-hr	2.90 (2.36-3.54)	3.46 (2.80-4.22)	4.36 (3.52-5.33)	5.11 (4.11-6.28)	6.15 (4.77-7.81)	6.92 (5.26-8.94)	7.74 (5.71-10.3)	8.70 (6.02-11.7)	10.1 (6.72-13.9)	11.3 (7.32-15.8)
2-day	3.24 (2.66-3.91)	3.90 (3.19-4.71)	4.98 (4.06-6.02)	5.87 (4.76-7.13)	7.10 (5.56-8.95)	8.01 (6.14-10.3)	8.99 (6.70-11.9)	10.2 (7.08-13.5)	11.9 (7.96-16.3)	13.4 (8.73-18.6)
3-day	3.52 (2.90-4.22)	4.22 (3.48-5.07)	5.38 (4.42-6.48)	6.35 (5.17-7.67)	7.67 (6.04-9.62)	8.65 (6.67-11.0)	9.71 (7.27-12.8)	11.0 (7.68-14.5)	12.9 (8.63-17.5)	14.5 (9.47-20.0)
4-day	3.77 (3.12-4.51)	4.51 (3.73-5.40)	5.73 (4.72-6.87)	6.74 (5.52-8.11)	8.13 (6.43-10.1)	9.16 (7.08-11.6)	10.3 (7.70-13.5)	11.6 (8.12-15.3)	13.6 (9.12-18.4)	15.3 (9.99-21.0)
7-day	4.49 (3.75-5.32)	5.30 (4.42-6.29)	6.63 (5.50-7.88)	7.73 (6.36-9.23)	9.24 (7.35-11.4)	10.4 (8.06-13.0)	11.6 (8.71-15.0)	13.0 (9.15-17.0)	15.1 (10.2-20.3)	16.8 (11.1-23.0)
10-day	5.20 (4.37-6.14)	6.05 (5.07-7.14)	7.44 (6.21-8.80)	8.59 (7.12-10.2)	10.2 (8.13-12.5)	11.4 (8.86-14.2)	12.6 (9.50-16.2)	14.0 (9.94-18.3)	16.1 (10.9-21.6)	17.8 (11.7-24.3)
20-day	7.39 (6.27-8.63)	8.30 (7.02-9.69)	9.78 (8.24-11.5)	11.0 (9.22-12.9)	12.7 (10.2-15.4)	14.0 (11.0-17.2)	15.3 (11.5-19.3)	16.7 (11.9-21.5)	18.5 (12.6-24.5)	19.9 (13.2-26.9)
30-day	9.21 (7.86-10.7)	10.2 (8.65-11.8)	11.7 (9.92-13.6)	13.0 (10.9-15.2)	14.7 (11.9-17.7)	16.1 (12.7-19.6)	17.5 (13.1-21.7)	18.8 (13.5-24.1)	20.4 (14.0-26.9)	21.6 (14.3-28.9)
45-day	11.5 (9.83-13.2)	12.5 (10.7-14.4)	14.1 (12.0-16.3)	15.5 (13.1-18.0)	17.3 (14.1-20.6)	18.8 (14.8-22.7)	20.2 (15.2-24.8)	21.4 (15.5-27.3)	22.9 (15.8-30.0)	23.9 (15.9-31.9)
60-day	13.3 (11.5-15.3)	14.4 (12.4-16.5)	16.1 (13.8-18.6)	17.5 (14.9-20.3)	19.5 (15.9-23.1)	21.1 (16.7-25.3)	22.6 (17.0-27.6)	23.8 (17.2-30.2)	25.2 (17.4-32.9)	26.0 (17.5-34.6)

¹ Precipitation frequency (PF) estimates in this table are based on frequency analysis of partial duration series (PDS)

36 X-CULVERT

Prepared by LBM Engineering LLC

HydroCAD® 10.20-6a s/n 09192 © 2024 HydroCAD Software Solutions LLC

GALESFERRY 50-yr Duration=15 min, Inten=5.48 in/hr

Printed 1/20/2025

Page 1

Summary for Subcatchment 1AB: AREA B

[48] Hint: Peak<CiA due to short duration

Runoff = 44.55 cfs @ 0.25 hrs, Volume= 70,079 cf, Depth= 0.32"
Routed to Pond 3P : 36" INLET


Runoff by Rational method, Rise/Fall=1.0/2.5 xTc, Time Span= 0.00-3.00 hrs, dt= 0.01 hrs
GALESFERRY 50-yr Duration=15 min, Inten=5.48 in/hr

Area (ac)	C	Description	Land Use
61.000	0.22	AREA TO X-ING	Meadow
61.000		100.00% Pervious Area	

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
25.0					Direct Entry, TO BASIN

Subcatchment 1AB: AREA B

Hydrograph

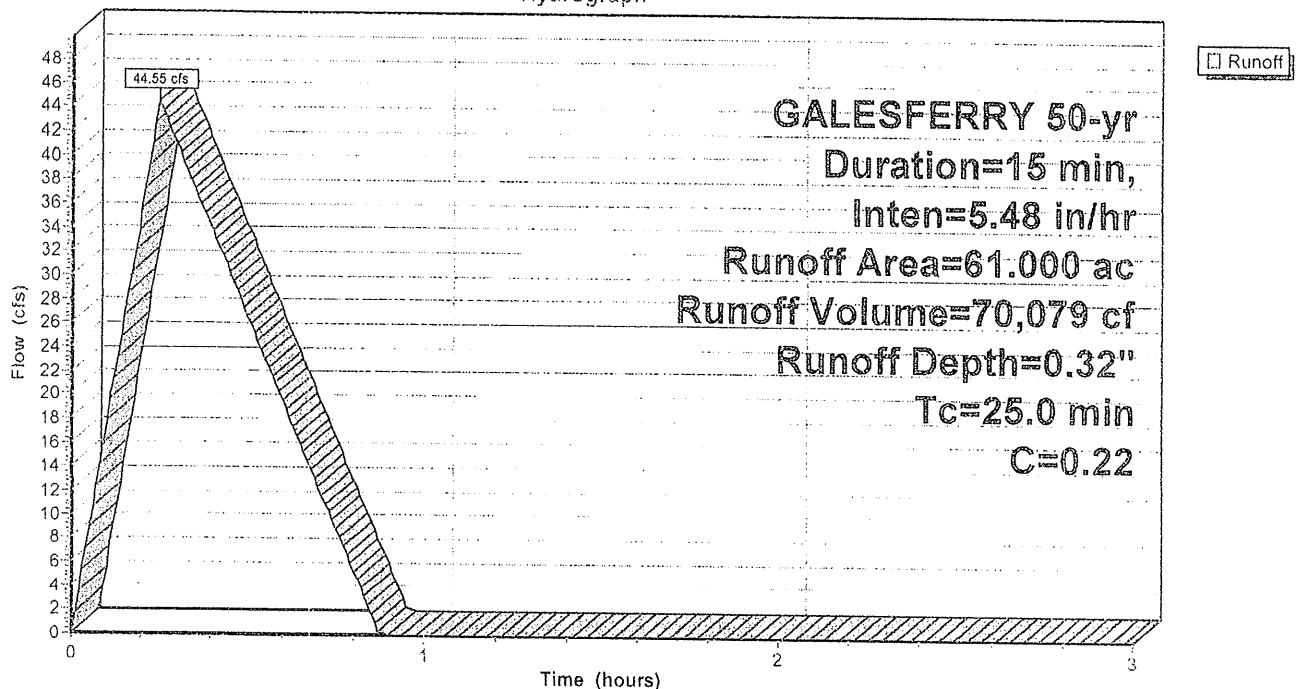

36 X-CULVERT

Prepared by LBM Engineering LLC

HydroCAD® 10.20-6a s/n 09192 © 2024 HydroCAD Software Solutions LLC

GALESFERRY 50-yr Duration=15 min, Inten=5.48 in/hr

Printed 1/20/2025

Page 2

Summary for Pond 3P: 36" INLET

[57] Hint: Peaked at 163.21' (Flood elevation advised)

Inflow Area = 2,657,160 sf, 0.00% Impervious, Inflow Depth = 0.32" for 50-yr event
Inflow = 44.55 cfs @ 0.25 hrs, Volume= 70,079 cf
Outflow = 44.55 cfs @ 0.25 hrs, Volume= 70,079 cf, Atten= 0%, Lag= 0.0 min
Primary = 44.55 cfs @ 0.25 hrs, Volume= 70,079 cf

Routing by Dyn-Stor-Ind method, Time Span= 0.00-3.00 hrs, dt= 0.01 hrs

Peak Elev= 163.21' @ 0.25 hrs


Device	Routing	Invert	Outlet Devices
#1	Primary	160.00'	36.0" Round Culvert L= 100.0' CPP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 160.00' / 154.00' S= 0.0600 '/ Cc= 0.900 n= 0.012 Corrugated PP, smooth interior, Flow Area= 7.07 sf

Primary OutFlow Max=44.34 cfs @ 0.25 hrs HW=163.20' (Free Discharge)

1=Culvert (Inlet Controls 44.34 cfs @ 6.27 fps)

Pond 3P: 36" INLET


Hydrograph

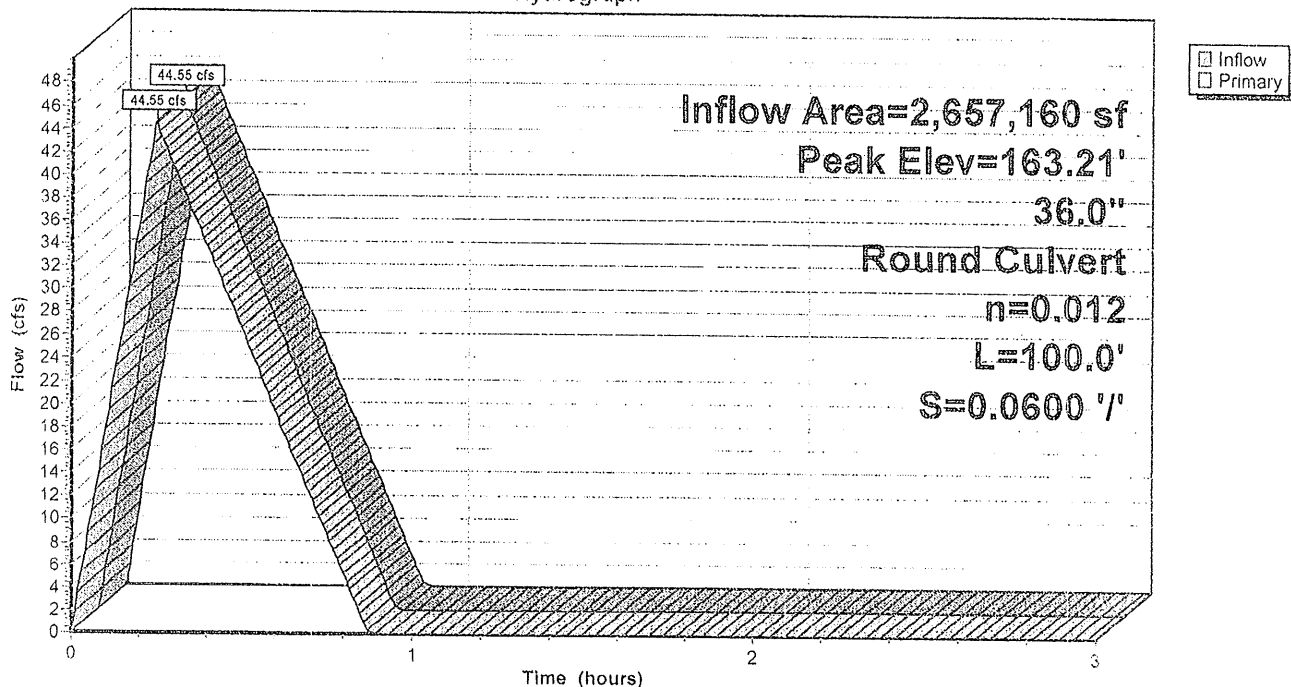

StreamStats Report

CROSS CULVERT
ELLIE ROSE LANE
STA 16+75

Region ID: CT
Workspace ID: CT20241015123229026000
Clicked Point (Latitude, Longitude): 41.41357, -72.06568
Time: 2024-10-15 08:32:51 -0400

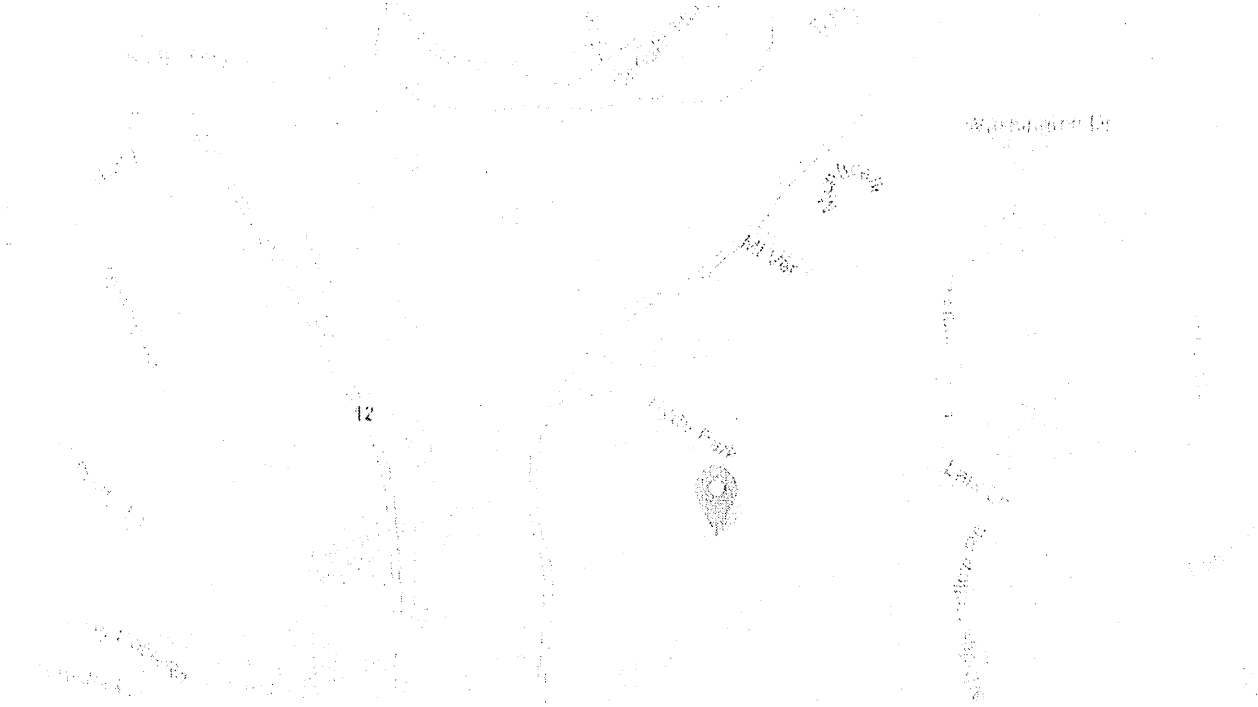

Collapse All

» Basin Characteristics

SEE PG 3 OF 5 FOR 50-YR FLOW

Parameter Code	Parameter Description	Value	Unit
CRSDFT	Percentage of area of coarse-grained stratified drift	0	percent
DRNAREA	Area that drains to a point on a stream	0.0949	square miles
ELEV	Mean Basin Elevation	258	feet
I24H100Y	Maximum 24-hour precipitation that occurs on average once in 100 years	7.74	inches
I24H10Y	Maximum 24-hour precipitation that occurs on average once in 10 years	5.05	inches
I24H200Y	Maximum 24-hour precipitation that occurs on average once in 200 years	8.82	inches
I24H25Y	Maximum 24-hour precipitation that occurs on average once in 25 years	6.12	inches

61 ACRES

Parameter Code	Parameter Description	Value	Unit
I24H2Y	Maximum 24-hour precipitation that occurs on average once in 2 years - Equivalent to precipitation intensity index	3.17	inches
I24H500Y	Maximum 24-hour precipitation that occurs on average once in 500 years	10.23	inches
I24H50Y	Maximum 24-hour precipitation that occurs on average once in 50 years	6.93	inches
I24H5Y	Maximum 24-hour precipitation that occurs on average once in 5 years	4.24	inches
SSURGOCCDD	Percentage of area with hydrologic soil types C, D, or C/D from SSURGO	0.0656	percent

➤ Peak-Flow Statistics

Peak-Flow Statistics Parameters [Statewide DA only SIR 2020 5054]

Parameter Code	Parameter Name	Value	Units	Min Limit	Max Limit
DRNAREA	Drainage Area	0.0949	square miles	0.69	325

Peak-Flow Statistics Parameters [Statewide Multiparameter SIR 2020 5054]

Parameter Code	Parameter Name	Value	Units	Min Limit	Max Limit
DRNAREA	Drainage Area	0.0949	square miles	0.69	325
I24H2Y	24 Hour 2 Year Precipitation	3.17	inches	2.77	3.32
SSURGOCCDD	Percent soil type C or D from SSURGO	0.0656	percent	0.118	0.945
I24H5Y	24 Hour 5 Year Precipitation	4.24	inches	4	4.7
I24H10Y	24 Hour 10 Year Precipitation	5.05	inches	4.86	5.79
I24H25Y	24 Hour 25 Year Precipitation	6.12	inches	5.99	7.22
I24H50Y	24 Hour 50 Year Precipitation	6.93	inches	6.81	8.3
I24H100Y	24 Hour 100 Year Precipitation	7.74	inches	7.62	9.38
I24H200Y	24 Hour 200 Year Precipitation	8.82	inches	8.7	11.22
I24H500Y	24 Hour 500 Year Precipitation	10.23	inches	10.1	13.64

Peak-Flow Statistics Disclaimers [Statewide DA only SIR 2020 5054]

One or more of the parameters is outside the suggested range. Estimates were extrapolated with unknown errors.

Peak-Flow Statistics Flow Report [Statewide DA only SIR 2020 5054]

Statistic	Value	Unit
Drainage Area Only 50-percent AEP flood	10.3	ft ³ /s
Drainage Area Only 20-percent AEP flood	18.5	ft ³ /s
Drainage Area Only 10-percent AEP flood	25.4	ft ³ /s
Drainage Area Only 4-percent AEP flood	35.6	ft ³ /s
Drainage Area Only 2-percent AEP flood	44.2	ft ³ /s
Drainage Area Only 1-percent AEP flood	53.5	ft ³ /s
Drainage Area Only 0.5-percent AEP flood	63.9	ft ³ /s
Drainage Area Only 0.2-percent AEP flood	79.2	ft ³ /s

Peak-Flow Statistics Disclaimers [Statewide Multiparameter SIR 2020 5054]

One or more of the parameters is outside the suggested range. Estimates were extrapolated with unknown errors.

Peak-Flow Statistics Flow Report [Statewide Multiparameter SIR 2020 5054]

Statistic	Value	Unit
50-percent AEP flood	5.38	ft ³ /s
20-percent AEP flood	8.85	ft ³ /s
10-percent AEP flood	11.6	ft ³ /s
4-percent AEP flood	15.9	ft ³ /s
2-percent AEP flood	19.5	ft ³ /s
1-percent AEP flood	23.5	ft ³ /s
0.5-percent AEP flood	28.7	ft ³ /s
0.2-percent AEP flood	36.3	ft ³ /s

Peak-Flow Statistics Flow Report [Area-Averaged]

Statistic	Value	Unit
Drainage Area Only 50-percent AEP flood	10.3	ft ³ /s
Drainage Area Only 20-percent AEP flood	18.5	ft ³ /s
Drainage Area Only 10-percent AEP flood	25.4	ft ³ /s
Drainage Area Only 4-percent AEP flood	35.6	ft ³ /s
Drainage Area Only 2-percent AEP flood	44.2	ft ³ /s
Drainage Area Only 1-percent AEP flood	53.5	ft ³ /s
Drainage Area Only 0.5-percent AEP flood	63.9	ft ³ /s
Drainage Area Only 0.2-percent AEP flood	79.2	ft ³ /s
50-percent AEP flood	5.38	ft ³ /s

Statistic	Value	Unit
20-percent AEP flood	8.85	ft ³ /s
10-percent AEP flood	11.6	ft ³ /s
4-percent AEP flood	15.9	ft ³ /s
2-percent AEP flood	19.5	ft ³ /s
1-percent AEP flood	23.5	ft ³ /s
0.5-percent AEP flood	28.7	ft ³ /s
0.2-percent AEP flood	36.3	ft ³ /s

Peak-Flow Statistics Citations

Ahearn, E.A., and Hodgkins, G.A., 2020, Estimating flood magnitude and frequency on streams and rivers in Connecticut, based on data through water year 2015: U.S. Geological Survey Scientific Investigations Report 2020-5054, 42 p. (<https://doi.org/10.3133/sir20205054>)

» Flow-Duration Statistics

Flow-Duration Statistics Parameters [Duration Flow 2010 5052]

Parameter Code	Parameter Name	Value	Units	Min Limit	Max Limit
DRNAREA	Drainage Area	0.0949	square miles	0.92	150
ELEV	Mean Basin Elevation	258	feet	168	1287
CRSDFT	Percent Coarse Stratified Drift	0	percent	0.1	55.1

Flow-Duration Statistics Disclaimers [Duration Flow 2010 5052]

One or more of the parameters is outside the suggested range. Estimates were extrapolated with unknown errors.

Flow-Duration Statistics Flow Report [Duration Flow 2010 5052]

Statistic	Value	Unit
25 Percent Duration	0.248	ft ³ /s
99 Percent Duration	0.0000495	ft ³ /s

Flow-Duration Statistics Citations

Ahearn, E.A., 2010, Regional regression equations to estimate flow-duration statistics in Connecticut: U. S. Geological Survey Scientific Investigations Report 2010-5052, 45 p. (<http://pubs.usgs.gov/sir/2010/5052/>)

➤ Maximum Probable Flood Statistics

Maximum Probable Flood Statistics Parameters [Crippen Bue Region 2]

Parameter Code	Parameter Name	Value	Units	Min Limit	Max Limit
DRNAREA	Drainage Area	0.0949	square miles	0.1	3000

Maximum Probable Flood Statistics Disclaimers [Crippen Bue Region 2]

One or more of the parameters is outside the suggested range. Estimates were extrapolated with unknown errors.

Maximum Probable Flood Statistics Flow Report [Crippen Bue Region 2]

Statistic	Value	Unit
Maximum Flood Crippen Bue Regional	1020	ft ³ /s

Maximum Probable Flood Statistics Citations

Crippen, J.R. and Bue, Conrad D. 1977, Maximum Floodflows in the Conterminous United States, Geological Survey Water-Supply Paper 1887, 52p. (<https://pubs.usgs.gov/wsp/1887/report.pdf>)

USGS Data Disclaimer: Unless otherwise stated, all data, metadata and related materials are considered to satisfy the quality standards relative to the purpose for which the data were collected. Although these data and associated metadata have been reviewed for accuracy and completeness and approved for release by the U.S. Geological Survey (USGS), no warranty expressed or implied is made regarding the display or utility of the data for other purposes, nor on all computer systems, nor shall the act of distribution constitute any such warranty.

USGS Software Disclaimer: This software has been approved for release by the U.S. Geological Survey (USGS). Although the software has been subjected to rigorous review, the USGS reserves the right to update the software as needed pursuant to further analysis and review. No warranty, expressed or implied, is made by the USGS or the U.S. Government as to the functionality of the software and related material nor shall the fact of release constitute any such warranty. Furthermore, the software is released on condition that neither the USGS nor the U.S. Government shall be held liable for any damages resulting from its authorized or unauthorized use.


USGS Product Names Disclaimer: Any use of trade, firm, or product names is for descriptive purposes only and does not imply endorsement by the U.S. Government.

Application Version: 4.24.0

StreamStats Services Version: 1.2.22

NSS Services Version: 2.2.1


CHART 2

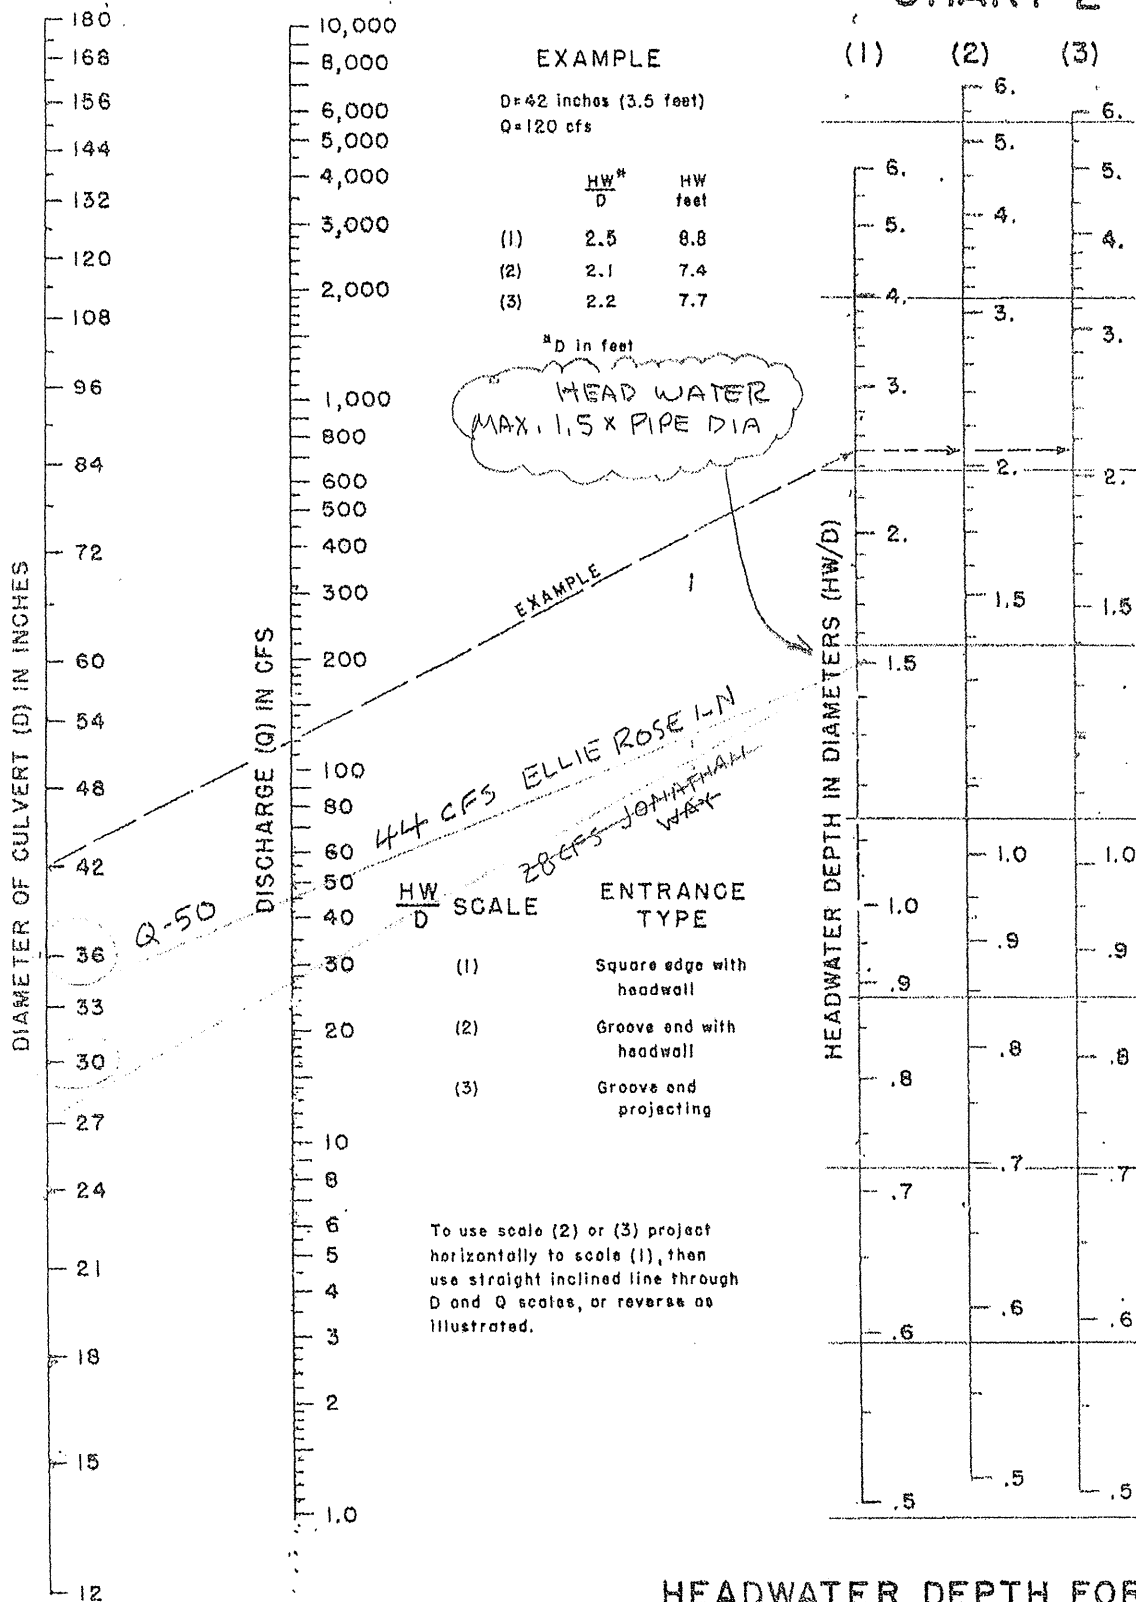

HEADWATER DEPTH FOR CONCRETE PIPE CULVERTS WITH INLET CONTROL

HEADWATER SCALES 2 & 3
REVISED MAY 1964

BUREAU OF PUBLIC ROADS JAN 1963

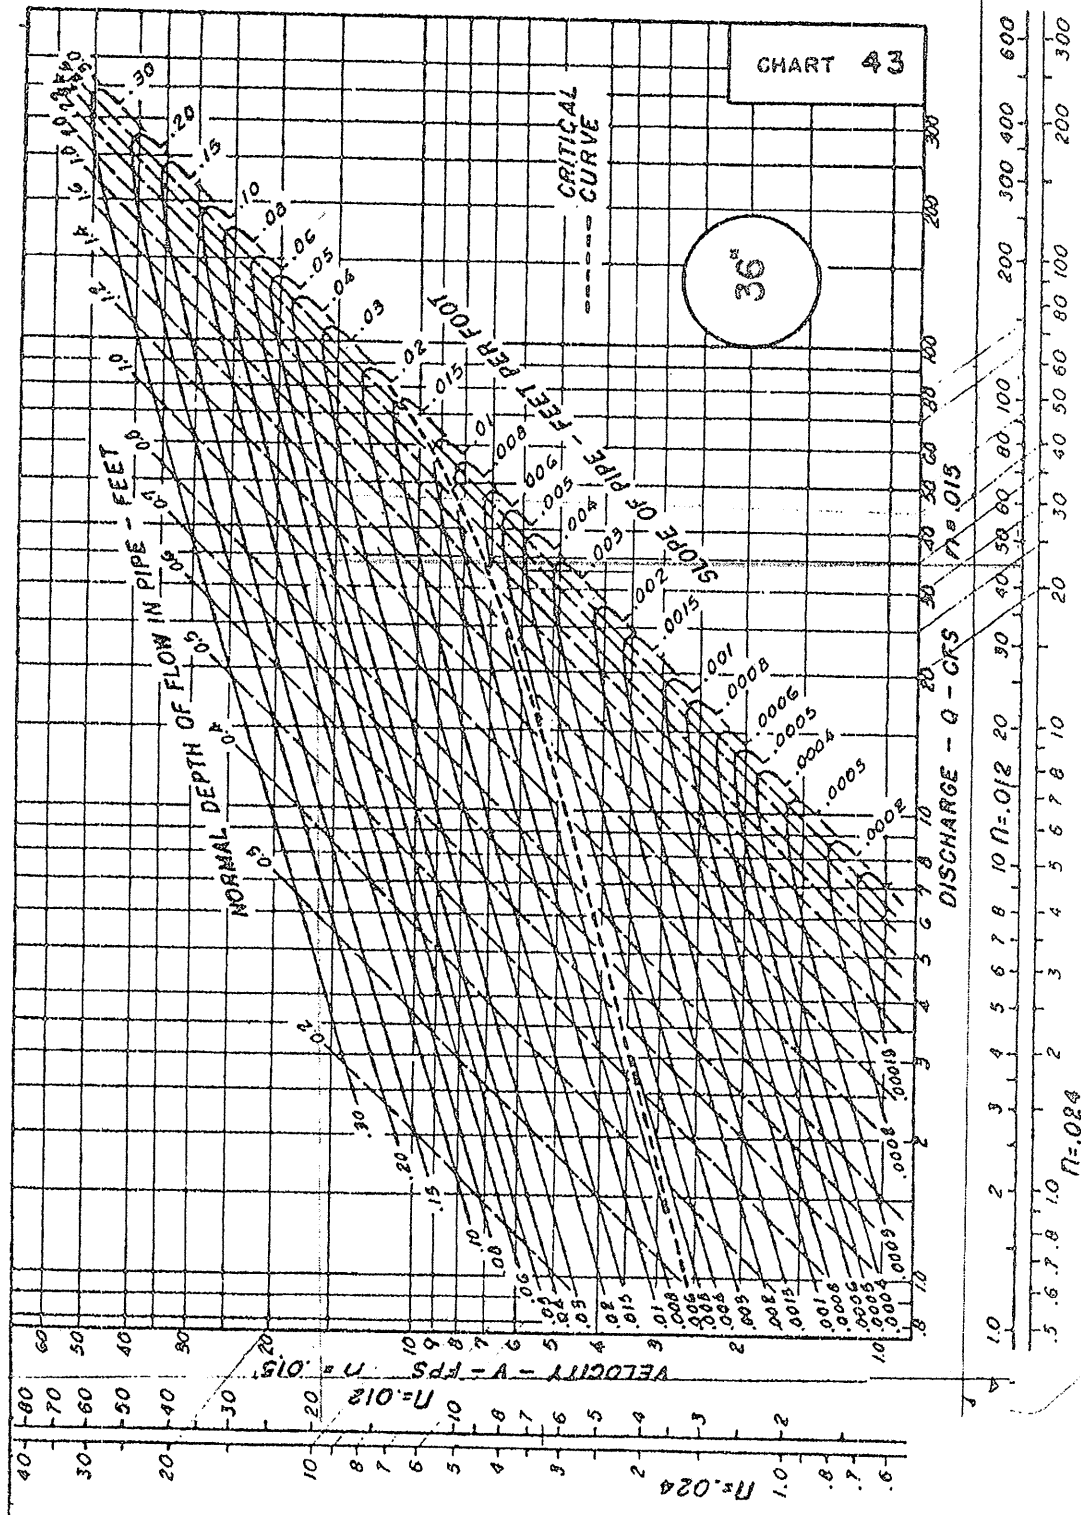

**PIPE FLOW CHART
36-INCH DIAMETER**

$N = 0.019$ LINE FOR C.M.P.

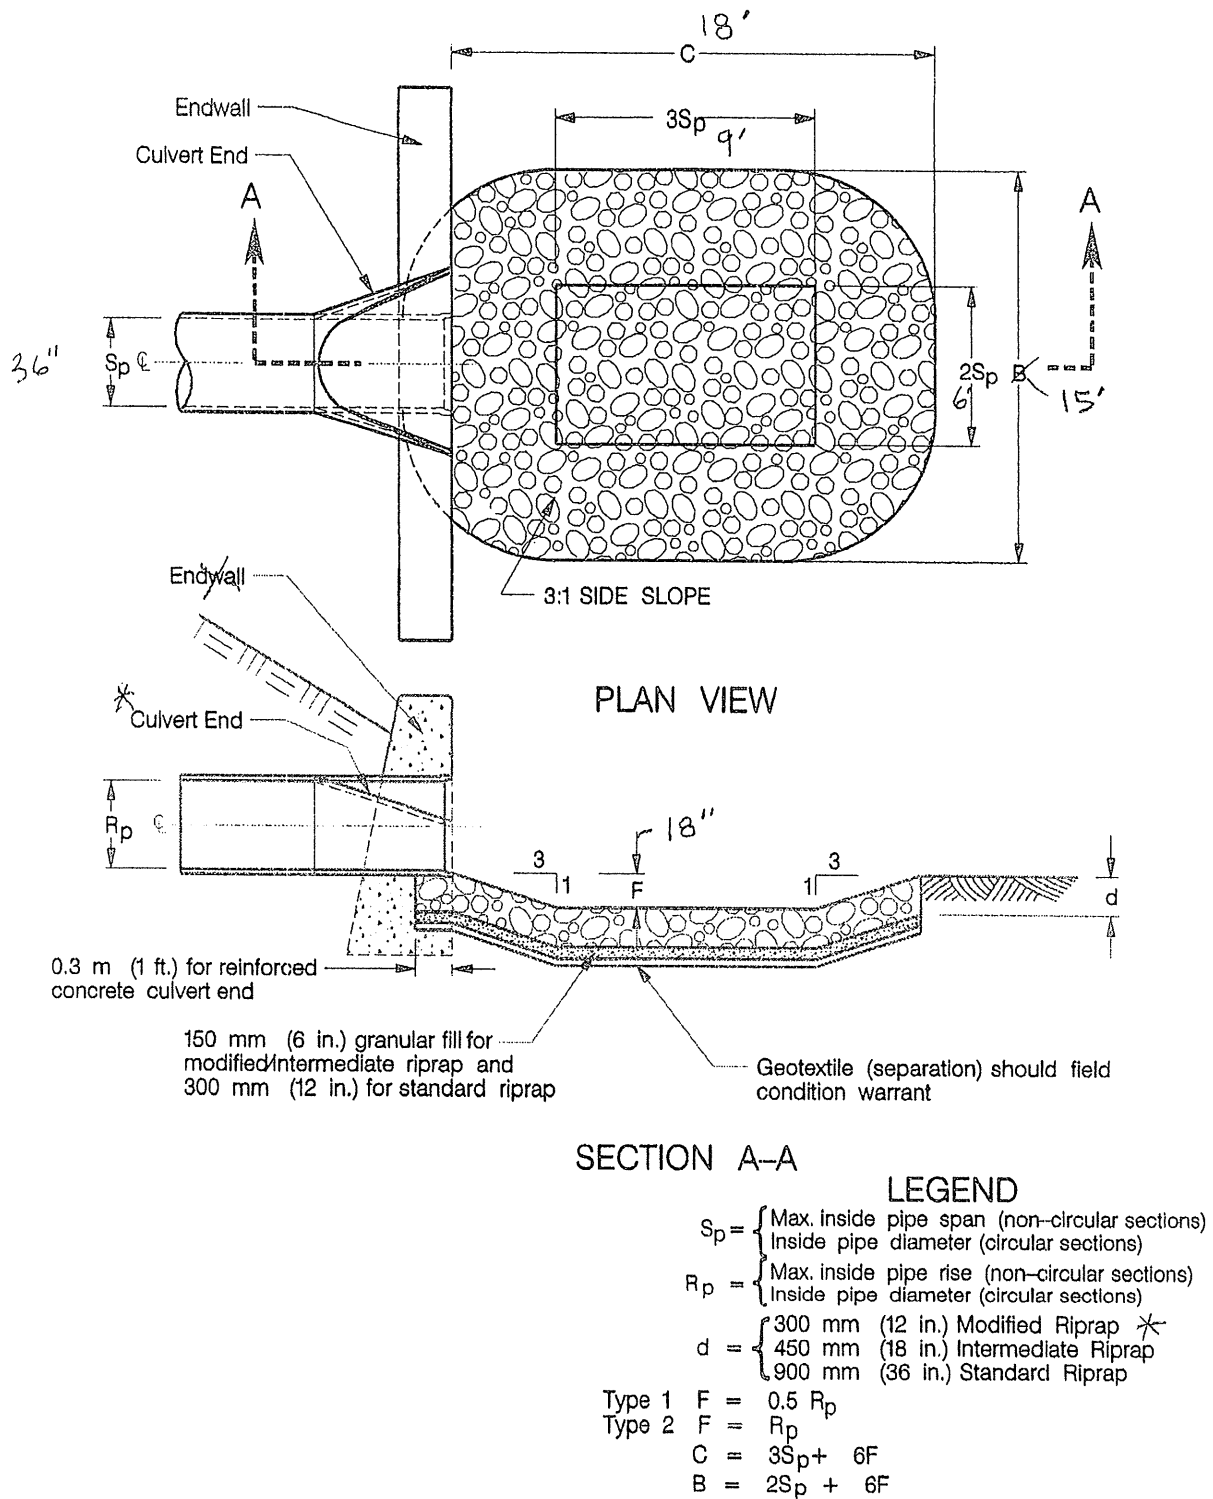


Figure 11-15 Preformed Scour Hole Type 1 and Type 2

OUTLET PROTECTION
OUTLET VELOCITY > 14 feet/sec or Length of Apron exceeds limits shown on
Tables 11-12.1 and 11-13.1

(See Figure 11-15)	Preformed Scour Hole									
	PIPE DIAMETER OR SPAN (in)									
	12	15	18	24	30	36	42	48	54	60
Type 1										
B	5	6	8	10	13	15	18	20	23	25
C	6	8	9	12	15	18	21	24	27	30
d	MODIFIED Depends on riprap type(see Figure 11-15)									
2S_p	2.0	2.6	3.0	4.0	5.0	6.0	7.0	8.0	9.0	10.0
3S_p	3.0	3.9	4.5	6.0	7.5	9.0	10.5	12.0	13.5	15.0
F = 0.5 S_p	0.5	0.625	0.75	1	1.25	1.5	1.75	2	2.25	2.5
Type 2										
B	8	10	12	16	20	24	28	32	36	40
C	9	11	14	18	23	27	32	36	41	45
d	Depends on riprap size (see Figure 11-15)									
2S_p	2.0	2.6	3.0	4.0	5.0	6.0	7.0	8.0	9.0	10.0
3S_p	3.0	3.9	4.5	6.0	7.5	9.0	10.5	12.0	13.5	15.0
F = S_p	1.0	1.3	1.5	2.0	2.5	3.0	3.5	4.0	4.5	5.0

Table 11-14.1 - Dimensions of Preformed Scour Hole (Feet)

Empirical Preformed Scour Hole Equations:

Type 1: Scour Hole Depression = one-half pipe rise, m (ft)

$$d_{50} = (0.0276 R_p^2 / TW) (Q/R_p^{2.5})^{1.333} \quad (d_{50} = (0.0125 R_p^2 / TW) (Q/R_p^{2.5})^{1.333}) = 0.22' \quad (11.35)$$

$\begin{matrix} 0.1125 & 2.823 \\ \hline (0.0125)(3^2)/1 & [(44/3^{2.5})^{1.333}] \end{matrix}$

Type 2: Scour Hole Depression = full pipe rise, m (ft)

$$d_{50} = (0.0181 R_p^2 / TW) (Q/R_p^{2.5})^{1.333} \quad (d_{50} = (0.0082 R_p^2 / TW) (Q/R_p^{2.5})^{1.333}) \quad (11.36)$$

$\begin{matrix} 44 \text{ CFS} \\ \hline (0.0082)(3^2)/1 & [(44/3^{2.5})^{1.333}] \end{matrix}$

d_{50} = median stone size required, m (ft)

For variables S_p , R_p , TW and Q , see Section 11.13.5.

$$R = 3' \\ Q = 45 \text{ CFS}$$

Type 1 and 2 preformed scour hole dimensions (See Figure 11-15)

$$C = 3S_p + 6F$$

Basin Length m (ft)

$$B = 2S_p + 6F$$

Basin Inlet and Outlet Width m (ft)

(11.37)

$$F = 0.5R_p \text{ (Type 1) or } R_p \text{ (Type 2)}$$


Basin Depression m (ft)

Table 11-14 solves the above set of equations for Type 1 and 2 preformed scour holes for various pipe sizes.

The type of riprap required is as follows:

Modified	$d_{50} < 0.13\text{m (0.42 ft)}$
Intermediate	$0.13\text{m (0.42 ft)} < d_{50} < 0.20\text{m (0.67 ft)}$
Standard	$0.20\text{m (0.67 ft)} < d_{50} < 0.38\text{m (1.25 ft)}$
Special Design	$0.38\text{m (1.25 ft)} < d_{50}$

Reference: Report No. FHWA-RD-75-508 ("Culvert Outlet Protection Design: Computer Program Documentation")

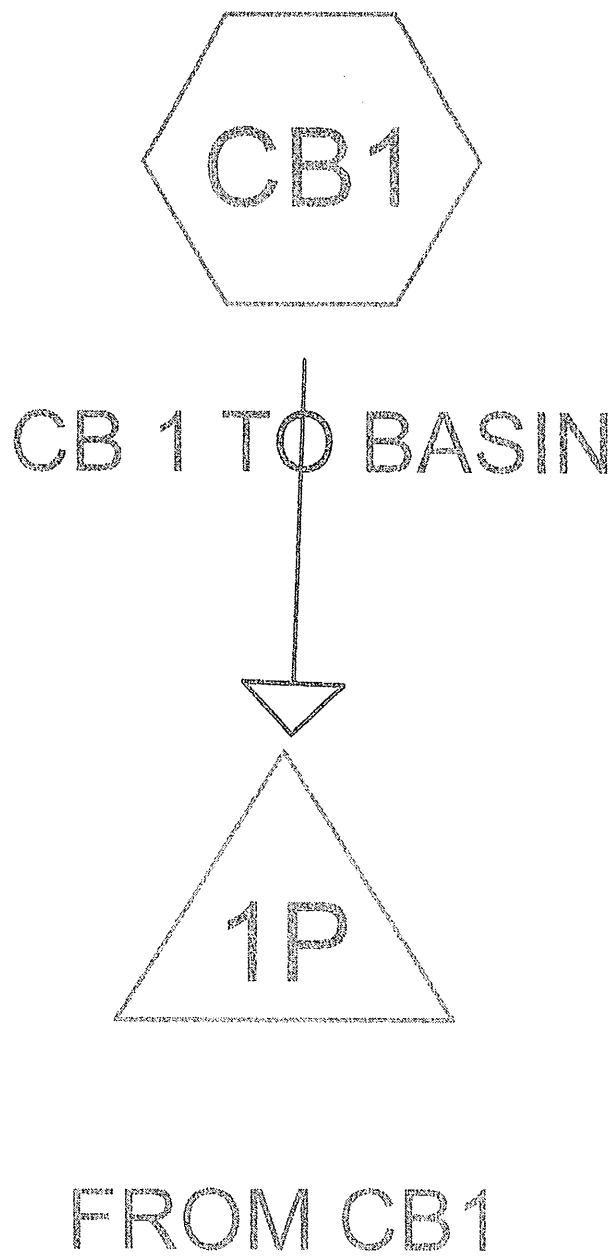

Routing Diagram for BASIN FROM CB1
Prepared by LBM Engineering LLC, Printed 6/19/2026
HydroCAD® 10.20-9a sm 09192 © 2026 HydroCAD Software Solutions LLC

BASIN FROM CB1

Prepared by LBM Engineering LLC

HydroCAD® 10.20-9a s/n 09192 © 2026 HydroCAD Software Solutions LLC

Gales Ferry 2 2-yr Duration=10 min, Inten=3.46 in/hr

Printed 6/19/2026

Page 2

Summary for Subcatchment CB1: CB 1 TO BASIN

Runoff = 0.66 cfs @ 0.17 hrs, Volume= 696 cf, Depth= 0.96"
 Routed to Pond 1P : FROM CB1

Runoff by Rational method, Rise/Fall=1.0/2.5 xTc, Time Span= 0.00-3.00 hrs, dt= 0.01 hrs
 Gales Ferry 2 2-yr Duration=10 min, Inten=3.46 in/hr

Area (ac)	C	Description	Land Use
0.200	0.95	AREA TO BASIN	Pavement
0.200		100.00% Impervious Area	

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.0					Direct Entry, TO BASIN

Summary for Pond 1P: FROM CB1

Inflow Area = 8,712 sf, 100.00% Impervious, Inflow Depth = 0.96" for 2-yr event
 Inflow = 0.66 cfs @ 0.17 hrs, Volume= 696 cf
 Outflow = 0.21 cfs @ 0.45 hrs, Volume= 693 cf, Atten= 68%, Lag= 16.7 min
 Primary = 0.21 cfs @ 0.45 hrs, Volume= 693 cf

Routing by Dyn-Stor-Ind method, Time Span= 0.00-3.00 hrs, dt= 0.01 hrs
 Peak Elev= 166.29' @ 0.45 hrs Surf.Area= 410 sf Storage= 406 cf

Plug-Flow detention time= 23.1 min calculated for 693 cf (100% of inflow)
 Center-of-Mass det. time= 23.0 min (38.0 - 15.0)

Volume	Invert	Avail. Storage	Storage Description
#1	165.00'	1,367 cf	Custom Stage Data (Prismatic) Listed below (Recalc)

Elevation (feet)	Surf. Area (sq-ft)	Inc. Store (cubic-feet)	Cum. Store (cubic-feet)
165.00	225	0	0
166.00	361	293	293
167.00	529	445	738
168.00	729	629	1,367

Device	Routing	Invert	Outlet Devices
#1	Primary	165.00'	3.0" Round Culvert L= 20.0' CPP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 165.00' / 164.60' S= 0.0200 ' Cc= 0.900 n= 0.012 Corrugated PP, smooth interior. Flow Area= 0.05 sf

Primary OutFlow Max=0.21 cfs @ 0.45 hrs HW=166.29' (Free Discharge)
 1=Culvert (Barrel Controls 0.21 cfs @ 4.36 fps)

BASIN FROM CB1

Gales Ferry 2 10-yr Duration=10 min, Inten=5.14 in/hr

Prepared by LBM Engineering LLC

Printed 6/19/2026

HydroCAD® 10.20-9a s/n 09192 © 2026 HydroCAD Software Solutions LLC

Page 3

Summary for Subcatchment CB1: CB 1 TO BASIN

Runoff = 0.98 cfs @ 0.17 hrs, Volume= 1,034 cf, Depth= 1.42"
 Routed to Pond 1P : FROM CB1

Runoff by Rational method, Rise/Fall=1.0/2.5 xTc, Time Span= 0.00-3.00 hrs, dt= 0.01 hrs
 Gales Ferry 2 10-yr Duration=10 min, Inten=5.14 in/hr

Area (ac)	C	Description	Land Use
0.200	0.95	AREA TO BASIN	Pavement
0.200		100.00% Impervious Area	

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.0					Direct Entry, TO BASIN

Summary for Pond 1P: FROM CB1

Inflow Area = 8,712 sf, 100.00% Impervious, Inflow Depth = 1.42" for 10-yr event
 Inflow = 0.98 cfs @ 0.17 hrs, Volume= 1,034 cf
 Outflow = 0.25 cfs @ 0.48 hrs, Volume= 1,030 cf, Atten= 74%, Lag= 18.3 min
 Primary = 0.25 cfs @ 0.48 hrs, Volume= 1,030 cf

Routing by Dyn-Stor-Ind method, Time Span= 0.00-3.00 hrs, dt= 0.01 hrs
 Peak Elev= 166.88' @ 0.48 hrs Surf.Area= 509 sf Storage= 675 cf

Plug-Flow detention time= 30.1 min calculated for 1,027 cf (99% of inflow)
 Center-of-Mass det. time= 30.4 min (45.4 - 15.0)

Volume	Invert	Avail. Storage	Storage Description
#1	165.00'	1,367 cf	Custom Stage Data (Prismatic) Listed below (Recalc)

Elevation (feet)	Surf. Area (sq-ft)	Inc. Store (cubic-feet)	Cum. Store (cubic-feet)
165.00	225	0	0
166.00	361	293	293
167.00	529	445	738
168.00	729	629	1,367

Device	Routing	Invert	Outlet Devices
#1	Primary	165.00'	3.0" Round Culvert L= 20.0' CPP, end-section conforming to fill. Ke= 0.500 Inlet / Outlet Invert= 165.00' / 164.60' S= 0.0200 ' / Cc= 0.900 n= 0.012 Corrugated PP, smooth interior, Flow Area= 0.05 sf

Primary OutFlow Max=0.25 cfs @ 0.48 hrs HW=166.88' (Free Discharge)
 ↑1=Culvert (Barrel Controls 0.25 cfs @ 5.17 fps)

BASIN FROM CB1

Gales Ferry 2 25-yr Duration=10 min, Inten=6.18 in/hr

Prepared by LBM Engineering LLC

Printed 6/19/2026

HydroCAD® 10.20-9a s/n 09192 © 2026 HydroCAD Software Solutions LLC

Page 4

Summary for Subcatchment CB1: CB 1 TO BASIN

Runoff = 1.17 cfs @ 0.17 hrs, Volume= 1,243 cf, Depth= 1.71"
 Routed to Pond 1P : FROM CB1

Runoff by Rational method, Rise/Fall=1.0/2.5 xTc, Time Span= 0.00-3.00 hrs, dt= 0.01 hrs
 Gales Ferry 2 25-yr Duration=10 min, Inten=6.18 in/hr

Area (ac)	C	Description	Land Use
0.200	0.95	AREA TO BASIN	Pavement
0.200		100.00% Impervious Area	

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.0					Direct Entry, TO BASIN

Summary for Pond 1P: FROM CB1

Inflow Area = 8,712 sf, 100.00% Impervious, Inflow Depth = 1.71" for 25-yr event
 Inflow = 1.17 cfs @ 0.17 hrs, Volume= 1,243 cf
 Outflow = 0.27 cfs @ 0.49 hrs, Volume= 1,238 cf, Atten= 77%, Lag= 19.0 min
 Primary = 0.27 cfs @ 0.49 hrs, Volume= 1,238 cf

Routing by Dyn-Stor-Ind method, Time Span= 0.00-3.00 hrs, dt= 0.01 hrs
 Peak Elev= 167.20' @ 0.49 hrs Surf.Area= 570 sf Storage= 850 cf

Plug-Flow detention time= 34.5 min calculated for 1,234 cf (99% of inflow)
 Center-of-Mass det. time= 34.7 min (49.7 - 15.0)

Volume	Invert	Avail.Storage	Storage Description
#1	165.00'	1,367 cf	Custom Stage Data (Prismatic) Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
165.00	225	0	0
166.00	361	293	293
167.00	529	445	738
168.00	729	629	1,367

Device	Routing	Invert	Outlet Devices
#1	Primary	165.00'	3.0" Round Culvert L= 20.0' CPP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 165.00' / 164.60' S= 0.0200 ' / Cc= 0.900 n= 0.012 Corrugated PP, smooth interior, Flow Area= 0.05 sf

Primary OutFlow Max=0.27 cfs @ 0.49 hrs HW=167.20' (Free Discharge)
 1=Culvert (Barrel Controls 0.27 cfs @ 5.56 fps)

BASIN FROM CB1

Gales Ferry 2 100-yr Duration=10 min, Inten=7.80 in/hr

Prepared by LBM Engineering LLC

Printed 6/19/2026

HydroCAD® 10.20-9a s/n 09192 © 2026 HydroCAD Software Solutions LLC

Page 5

Summary for Subcatchment CB1: CB 1 TO BASIN

Runoff = 1.48 cfs @ 0.17 hrs, Volume= 1,569 cf, Depth= 2.16"
 Routed to Pond 1P : FROM CB1

Runoff by Rational method, Rise/Fall=1.0/2.5 xTc, Time Span= 0.00-3.00 hrs, dt= 0.01 hrs
 Gales Ferry 2 100-yr Duration=10 min, Inten=7.80 in/hr

Area (ac)	C	Description	Land Use
0.200	0.95	AREA TO BASIN	Pavement
0.200		100.00% Impervious Area	

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.0					Direct Entry, TO BASIN

Summary for Pond 1P: FROM CB1

Inflow Area = 8,712 sf, 100.00% Impervious, Inflow Depth = 2.16" for 100-yr event
 Inflow = 1.48 cfs @ 0.17 hrs, Volume= 1,569 cf
 Outflow = 0.30 cfs @ 0.50 hrs, Volume= 1,563 cf, Atten= 80%, Lag= 19.8 min
 Primary = 0.30 cfs @ 0.50 hrs, Volume= 1,563 cf

Routing by Dyn-Stor-Ind method, Time Span= 0.00-3.00 hrs, dt= 0.01 hrs
 Peak Elev= 167.66' @ 0.50 hrs Surf.Area= 661 sf Storage= 1,131 cf


Plug-Flow detention time= 41.0 min calculated for 1,558 cf (99% of inflow)
 Center-of-Mass det. time= 41.2 min (56.2 - 15.0)

Volume #1	Invert	Avail.Storage	Storage Description
	165.00'	1,367 cf	Custom Stage Data (Prismatic) Listed below (Recalc)


Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
165.00	225	0	0
166.00	361	293	293
167.00	529	445	738
168.00	729	629	1,367

Device	Routing	Invert	Outlet Devices
#1	Primary	165.00'	3.0" Round Culvert L= 20.0' CPP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 165.00' / 164.60' S= 0.0200 ' Cc= 0.900 n= 0.012 Corrugated PP, smooth interior, Flow Area= 0.05 sf

Primary OutFlow Max=0.30 cfs @ 0.50 hrs HW=167.66' (Free Discharge)
 1=Culvert (Barrel Controls 0.30 cfs @ 6.08 fps)

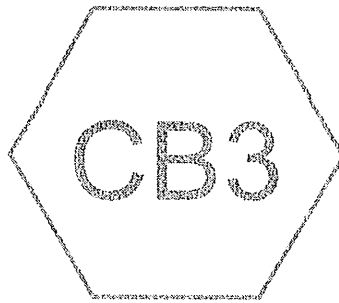

CB 3 TO BASIN

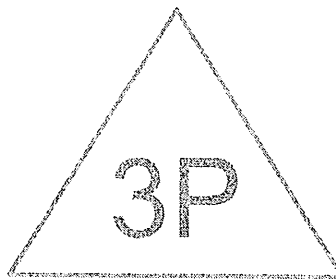

FROM CB3



Routing Diagram for BASIN FROM CB3
Prepared by LBM Engineering LLC. Printed 6/19/2026
HydroCAD® 10.20-9a s/n 09192 © 2026 HydroCAD Software Solutions LLC

BASIN FROM CB3

Gales Ferry 2 2-yr Duration=10 min, Inten=3.46 in/hr

Prepared by LBM Engineering LLC

Printed 6/19/2026

HydroCAD® 10.20-9a s/n 09192 ©'2026 HydroCAD Software Solutions LLC

Page 2

Summary for Subcatchment CB3: CB 3 TO BASIN

Runoff = 1.51 cfs @ 0.17 hrs, Volume= 1,601 cf, Depth= 0.96"
 Routed to Pond 3P : FROM CB3

Runoff by Rational method, Rise/Fall=1.0/2.5 xTc, Time Span= 0.00-3.00 hrs, dt= 0.01 hrs
 Gales Ferry 2 2-yr Duration=10 min, Inten=3.46 in/hr

Area (ac)	C	Description	Land Use
0.460	0.95	AREA TO BASIN	Pavement
0.460		100.00% Impervious Area	

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.0					Direct Entry, TO BASIN

Summary for Pond 3P: FROM CB3

Inflow Area = 20,038 sf, 100.00% Impervious, Inflow Depth = 0.96" for 2-yr event
 Inflow = 1.51 cfs @ 0.17 hrs, Volume= 1,601 cf
 Outflow = 0.43 cfs @ 0.47 hrs, Volume= 1,577 cf, Atten= 72%, Lag= 17.8 min
 Primary = 0.43 cfs @ 0.47 hrs, Volume= 1,577 cf

Routing by Dyn-Stor-Ind method, Time Span= 0.00-3.00 hrs, dt= 0.01 hrs
 Peak Elev= 153.35' @ 0.47 hrs Surf.Area= 927 sf Storage= 1,038 cf

Plug-Flow detention time= 30.5 min calculated for 1,577 cf (98% of inflow)
 Center-of-Mass det. time= 30.2 min (45.2 - 15.0)

Volume	Invert	Avail.Storage	Storage Description
#1	152.00'	2,927 cf	Custom Stage Data (Prismatic) Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
152.00	625	0	0
153.00	841	733	733
154.00	1,089	965	1,698
155.00	1,369	1,229	2,927

Device	Routing	Invert	Outlet Devices
#1	Primary	152.00'	4.0" Round Culvert L= 20.0' CPP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 152.00' / 151.60' S= 0.0200 ' Cc= 0.900 n= 0.012 Corrugated PP, smooth interior, Flow Area= 0.09 sf

Primary OutFlow Max=0.43 cfs @ 0.47 hrs HW=153.35' (Free Discharge)
 1=Culvert (Barrel Controls 0.43 cfs @ 4.88 fps)

BASIN FROM CB3

Prepared by LBM Engineering LLC

HydroCAD® 10.20-9a s/n 09192 © 2026 HydroCAD Software Solutions LLC

Gales Ferry 2 10-yr Duration=10 min, Inten=5.14 in/hr

Printed 6/19/2026

Page 3

Summary for Subcatchment CB3: CB 3 TO BASIN

Runoff = 2.25 cfs @ 0.17 hrs, Volume= 2,379 cf, Depth= 1.42"
 Routed to Pond 3P : FROM CB3

Runoff by Rational method, Rise/Fall=1.0/2.5 xTc, Time Span= 0.00-3.00 hrs, dt= 0.01 hrs
 Gales Ferry 2 10-yr Duration=10 min, Inten=5.14 in/hr

Area (ac)	C	Description	Land Use
0.460	0.95	AREA TO BASIN	Pavement
0.460		100.00% Impervious Area	

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.0					Direct Entry, TO BASIN

Summary for Pond 3P: FROM CB3

Inflow Area = 20,038 sf, 100.00% Impervious, Inflow Depth = 1.42" for 10-yr event
 Inflow = 2.25 cfs @ 0.17 hrs, Volume= 2,379 cf
 Outflow = 0.51 cfs @ 0.49 hrs, Volume= 2,348 cf, Atten= 77%, Lag= 19.1 min
 Primary = 0.51 cfs @ 0.49 hrs, Volume= 2,348 cf

Routing by Dyn-Stor-Ind method, Time Span= 0.00-3.00 hrs, dt= 0.01 hrs
 Peak Elev= 153.98' @ 0.49 hrs Surf.Area= 1,083 sf Storage= 1,672 cf

Plug-Flow detention time= 37.6 min calculated for 2,340 cf (98% of inflow)
 Center-of-Mass det. time= 37.7 min (52.7 - 15.0)

Volume	Invert	Avail.Storage	Storage Description
#1	152.00'	2,927 cf	Custom Stage Data (Prismatic) Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
152.00	625	0	0
153.00	841	733	733
154.00	1,089	965	1,698
155.00	1,369	1,229	2,927

Device	Routing	Invert	Outlet Devices
#1	Primary	152.00'	4.0" Round Culvert L= 20.0' CPP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 152.00' / 151.60' S= 0.0200 ' / Cc= 0.900 n= 0.012 Corrugated PP, smooth interior, Flow Area= 0.09 sf

Primary OutFlow Max=0.51 cfs @ 0.49 hrs HW=153.98' (Free Discharge)
 1=Culvert (Barrel Controls 0.51 cfs @ 5.87 fps)

BASIN FROM CB3

Gales Ferry 2 25-yr Duration=10 min, Inten=6.18 in/hr

Prepared by LBM Engineering LLC

Printed 6/19/2026

HydroCAD® 10.20-9a s/n 09192 © 2026 HydroCAD Software Solutions LLC

Page 4

Summary for Subcatchment CB3: CB 3 TO BASIN

Runoff = 2.70 cfs @ 0.17 hrs, Volume= 2,859 cf, Depth= 1.71"
 Routed to Pond 3P : FROM CB3

Runoff by Rational method, Rise/Fall=1.0/2.5 xTc, Time Span= 0.00-3.00 hrs, dt= 0.01 hrs
 Gales Ferry 2 25-yr Duration=10 min, Inten=6.18 in/hr

Area (ac)	C	Description	Land Use
0.460	0.95	AREA TO BASIN	Pavement
0.460		100.00% Impervious Area	

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.0					Direct Entry, TO BASIN

Summary for Pond 3P: FROM CB3

Inflow Area = 20.038 sf, 100.00% Impervious, Inflow Depth = 1.71" for 25-yr event
 Inflow = 2.70 cfs @ 0.17 hrs, Volume= 2,859 cf
 Outflow = 0.56 cfs @ 0.50 hrs, Volume= 2,823 cf, Atten= 79%, Lag= 19.7 min
 Primary = 0.56 cfs @ 0.50 hrs, Volume= 2,823 cf

Routing by Dyn-Stor-Ind method, Time Span= 0.00-3.00 hrs, dt= 0.01 hrs
 Peak Elev= 154.34' @ 0.50 hrs Surf.Area= 1,183 sf Storage= 2,080 cf

Plug-Flow detention time= 42.4 min calculated for 2,823 cf (99% of inflow)
 Center-of-Mass det. time= 42.2 min (57.2 - 15.0)

Volume	Invert	Avail.Storage	Storage Description
#1	152.00'	2,927 cf	Custom Stage Data (Prismatic) Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
152.00	625	0	0
153.00	841	733	733
154.00	1,089	965	1,698
155.00	1,369	1,229	2,927

Device	Routing	Invert	Outlet Devices
#1	Primary	152.00'	4.0" Round Culvert L= 20.0' CPP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 152.00' / 151.60' S= 0.0200 ' S= 0.0200 ' Cc= 0.900 n= 0.012 Corrugated PP, smooth interior, Flow Area= 0.09 sf

Primary OutFlow Max=0.56 cfs @ 0.50 hrs HW=154.34' (Free Discharge)

1=Culvert (Barrel Controls 0.56 cfs @ 6.37 fps)

BASIN FROM CB3

Gales Ferry 2 100-yr Duration=10 min, Inten=7.80 in/hr

Prepared by LBM Engineering LLC

Printed 6/19/2026

HydroCAD® 10.20-9a s/n 09192 © 2026 HydroCAD Software Solutions LLC

Page 5

Summary for Subcatchment CB3: CB 3 TO BASIN

Runoff = 3.41 cfs @ 0.17 hrs, Volume= 3,608 cf, Depth= 2.16"
 Routed to Pond 3P : FROM CB3

Runoff by Rational method, Rise/Fall=1.0/2.5 xTc, Time Span= 0.00-3.00 hrs, dt= 0.01 hrs
 Gales Ferry 2 100-yr Duration=10 min, Inten=7.80 in/hr

Area (ac)	C	Description	Land Use
0.460	0.95	AREA TO BASIN	Pavement
0.460		100.00% Impervious Area	

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.0					Direct Entry, TO BASIN

Summary for Pond 3P: FROM CB3

Inflow Area = 20,038 sf, 100.00% Impervious, Inflow Depth = 2.16" for 100-yr event
 Inflow = 3.41 cfs @ 0.17 hrs, Volume= 3,608 cf
 Outflow = 0.61 cfs @ 0.51 hrs, Volume= 3,560 cf, Atten= 82%, Lag= 20.3 min
 Primary = 0.61 cfs @ 0.51 hrs, Volume= 3,560 cf

Routing by Dyn-Stor-Ind method, Time Span= 0.00-3.00 hrs, dt= 0.01 hrs
 Peak Elev= 154.86' @ 0.51 hrs Surf.Area= 1,329 sf Storage= 2,732 cf


Plug-Flow detention time= 48.7 min calculated for 3,548 cf (98% of inflow)
 Center-of-Mass det. time= 48.8 min (63.8 - 15.0)

Volume	Invert	Avail.Storage	Storage Description
#1	152.00'	2,927 cf	Custom Stage Data (Prismatic) Listed below (Recalc)



Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
152.00	625	0	0
153.00	841	733	733
154.00	1,089	965	1,698
155.00	1,369	1,229	2,927

Device	Routing	Invert	Outlet Devices
#1	Primary	152.00'	4.0" Round Culvert L= 20.0' CPP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 152.00' / 151.60' S= 0.0200 ' S= 0.0200 ' Cc= 0.900 n= 0.012 Corrugated PP, smooth interior, Flow Area= 0.09 sf

Primary OutFlow Max=0.61 cfs @ 0.51 hrs HW=154.86' (Free Discharge)
 1=Culvert (Barrel Controls 0.61 cfs @ 7.02 fps)

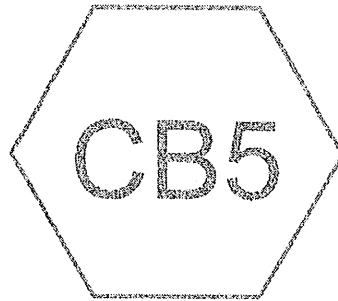

CB 5 TO BASIN

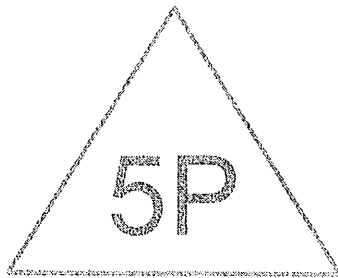

FROM CB5



Routing Diagram for BASIN FROM CB5
Prepared by LBM Engineering LLC. Printed 6/19/2026
HydroCAD® 10.20-9a s/n 09192 © 2026 HydroCAD Software Solutions LLC

BASIN FROM CB5

Gales Ferry 2 2-yr Duration=10 min, Inten=3.46 in/hr

Prepared by LBM Engineering LLC

Printed 6/19/2026

HydroCAD® 10.20-9a s/n 09192 © 2026 HydroCAD Software Solutions LLC

Page 2

Summary for Subcatchment CB5: CB 5 TO BASIN

Runoff = 1.15 cfs @ 0.17 hrs, Volume= 1,218 cf, Depth= 0.96"
 Routed to Pond 5P : FROM CB5

Runoff by Rational method, Rise/Fall=1.0/2.5 xTc, Time Span= 0.00-3.00 hrs, dt= 0.01 hrs
 Gales Ferry 2 2-yr Duration=10 min, Inten=3.46 in/hr

Area (ac)	C	Description	Land Use
0.350	0.95	AREA TO BASIN	Pavement
0.350		100.00% Impervious Area	

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.0					Direct Entry, TO BASIN

Summary for Pond 5P: FROM CB5

Inflow Area = 15,246 sf, 100.00% Impervious, Inflow Depth = 0.96" for 2-yr event
 Inflow = 1.15 cfs @ 0.17 hrs, Volume= 1,218 cf
 Outflow = 0.37 cfs @ 0.45 hrs, Volume= 1,197 cf, Atten= 68%, Lag= 16.7 min
 Primary = 0.37 cfs @ 0.45 hrs, Volume= 1,197 cf

Routing by Dyn-Stor-Ind method, Time Span= 0.00-3.00 hrs, dt= 0.01 hrs
 Peak Elev= 162.01' @ 0.45 hrs Surf.Area= 844 sf Storage= 745 cf

Plug-Flow detention time= 26.5 min calculated for 1,193 cf (98% of inflow)
 Center-of-Mass det. time= 26.6 min (41.6 - 15.0)

Volume	Invert	Avail.Storage	Storage Description
#1	161.00'	2,927 cf	Custom Stage Data (Prismatic) Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
161.00	625	0	0
162.00	841	733	733
163.00	1,089	965	1,698
164.00	1,369	1,229	2,927

Device	Routing	Invert	Outlet Devices
#1	Primary	161.00'	4.0" Round Culvert L= 20.0' CPP, end-section conforming to fill. Ke= 0.500 Inlet / Outlet Invert= 161.00' / 160.60' S= 0.0200 ' S= 0.900 n= 0.012 Corrugated PP, smooth interior, Flow Area= 0.09 sf

Primary OutFlow Max=0.37 cfs @ 0.45 hrs HW=162.01' (Free Discharge)
 1=Culvert (Barrel Controls 0.37 cfs @ 4.27 fps)

BASIN FROM CB5

Gales Ferry 2 10-yr Duration=10 min, Inten=5.14 in/hr

Prepared by LBM Engineering LLC

Printed 6/19/2026

HydroCAD® 10.20-9a s/n 09192 © 2026 HydroCAD Software Solutions LLC

Page 3

Summary for Subcatchment CB5: CB 5 TO BASIN

Runoff = 1.71 cfs @ 0.17 hrs, Volume= 1,810 cf, Depth= 1.42"
 Routed to Pond 5P : FROM CB5

Runoff by Rational method, Rise/Fall=1.0/2.5 xTc, Time Span= 0.00-3.00 hrs, dt= 0.01 hrs
 Gales Ferry 2 10-yr Duration=10 min, Inten=5.14 in/hr

Area (ac)	C	Description	Land Use
0.350	0.95	AREA TO BASIN	Pavement
0.350		100.00% Impervious Area	

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.0					Direct Entry, TO BASIN

Summary for Pond 5P: FROM CB5

Inflow Area = 15,246 sf, 100.00% Impervious, Inflow Depth = 1.42" for 10-yr event
 Inflow = 1.71 cfs @ 0.17 hrs, Volume= 1,810 cf
 Outflow = 0.45 cfs @ 0.47 hrs, Volume= 1,784 cf, Atten= 74%, Lag= 18.2 min
 Primary = 0.45 cfs @ 0.47 hrs, Volume= 1,784 cf

Routing by Dyn-Stor-Ind method, Time Span= 0.00-3.00 hrs, dt= 0.01 hrs
 Peak Elev= 162.52' @ 0.47 hrs Surf.Area= 970 sf Storage= 1,204 cf

Plug-Flow detention time= 32.5 min calculated for 1,784 cf (99% of inflow)
 Center-of-Mass det. time= 32.3 min (47.3 - 15.0)

Volume	Invert	Avail. Storage	Storage Description
#1	161.00'	2,927 cf	Custom Stage Data (Prismatic) Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
161.00	625	0	0
162.00	841	733	733
163.00	1,089	965	1,698
164.00	1,369	1,229	2,927

Device	Routing	Invert	Outlet Devices
#1	Primary	161.00'	4.0" Round Culvert L= 20.0' CPP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 161.00' / 160.60' S= 0.0200 ' S= 0.0200 ' Cc= 0.900 n= 0.012 Corrugated PP, smooth interior. Flow Area= 0.09 sf

Primary OutFlow Max=0.45 cfs @ 0.47 hrs HW=162.52' (Free Discharge)
 1=Culvert (Barrel Controls 0.45 cfs @ 5.18 fps)

BASIN FROM CB5

Gales Ferry 2 25-yr Duration=10 min, Inten=6.18 in/hr

Prepared by LBM Engineering LLC

Printed 6/19/2026

HydroCAD® 10.20-9a s/n 09192 © 2026 HydroCAD Software Solutions LLC

Page 4

Summary for Subcatchment CB5: CB 5 TO BASIN

Runoff = 2.06 cfs @ 0.17 hrs, Volume= 2,175 cf, Depth= 1.71"
 Routed to Pond 5P : FROM CB5

Runoff by Rational method, Rise/Fall=1.0/2.5 xTc, Time Span= 0.00-3.00 hrs, dt= 0.01 hrs
 Gales Ferry 2 25-yr Duration=10 min, Inten=6.18 in/hr

Area (ac)	C	Description	Land Use
0.350	0.95	AREA TO BASIN	Pavement
0.350		100.00% Impervious Area	

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.0					Direct Entry, TO BASIN

Summary for Pond 5P: FROM CB5

Inflow Area = 15,246 sf, 100.00% Impervious, Inflow Depth = 1.71" for 25-yr event
 Inflow = 2.06 cfs @ 0.17 hrs, Volume= 2,175 cf
 Outflow = 0.49 cfs @ 0.48 hrs, Volume= 2,146 cf, Atten= 76%, Lag= 18.8 min
 Primary = 0.49 cfs @ 0.48 hrs, Volume= 2,146 cf

Routing by Dyn-Stor-Ind method, Time Span= 0.00-3.00 hrs, dt= 0.01 hrs
 Peak Elev= 162.82' @ 0.48 hrs Surf.Area= 1,044 sf Storage= 1,503 cf

Plug-Flow detention time= 35.7 min calculated for 2,139 cf (98% of inflow)
 Center-of-Mass det. time= 35.8 min (50.8 - 15.0)

Volume	Invert	Avail. Storage	Storage Description
#1	161.00'	2,927 cf	Custom Stage Data (Prismatic) Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
161.00	625	0	0
162.00	841	733	733
163.00	1,089	965	1,698
164.00	1,369	1,229	2,927

Device	Routing	Invert	Outlet Devices
#1	Primary	161.00'	4.0" Round Culvert L= 20.0' CPP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 161.00' / 160.60' S= 0.0200' / Cc= 0.900 n= 0.012 Corrugated PP, smooth interior, Flow Area= 0.09 sf

Primary OutFlow Max=0.49 cfs @ 0.48 hrs HW=162.82' (Free Discharge)
 1=Culvert (Barrel Controls 0.49 cfs @ 5.64 fps)

BASIN FROM CB5

Gales Ferry 2 100-yr Duration=10 min, Inten=7.80 in/hr

Prepared by LBM Engineering LLC

Printed 6/19/2026

HydroCAD® 10.20-9a s/n 09192 © 2026 HydroCAD Software Solutions LLC

Page 5

Summary for Subcatchment CB5: CB 5 TO BASIN

Runoff = 2.59 cfs @ 0.17 hrs, Volume= 2,745 cf, Depth= 2.16"
 Routed to Pond 5P : FROM CB5

Runoff by Rational method, Rise/Fall=1.0/2.5 xTc, Time Span= 0.00-3.00 hrs, dt= 0.01 hrs
 Gales Ferry 2 100-yr Duration=10 min, Inten=7.80 in/hr

Area (ac)	C	Description	Land Use
0.350	0.95	AREA TO BASIN	Pavement
0.350		100.00% Impervious Area	

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.0					Direct Entry, TO BASIN

Summary for Pond 5P: FROM CB5

Inflow Area = 15,246 sf, 100.00% Impervious, Inflow Depth = 2.16" for 100-yr event
 Inflow = 2.59 cfs @ 0.17 hrs, Volume= 2,745 cf
 Outflow = 0.55 cfs @ 0.50 hrs, Volume= 2,711 cf, Atten= 79%, Lag= 19.5 min
 Primary = 0.55 cfs @ 0.50 hrs, Volume= 2,711 cf

Routing by Dyn-Stor-Ind method, Time Span= 0.00-3.00 hrs, dt= 0.01 hrs
 Peak Elev= 163.25' @ 0.50 hrs Surf.Area= 1,160 sf Storage= 1,983 cf

Plug-Flow detention time= 41.4 min calculated for 2,711 cf (99% of inflow)
 Center-of-Mass det. time= 41.1 min (56.1 - 15.0)


Volume #1	Invert	Avail.Storage	Storage Description
	161.00'	2,927 cf	Custom Stage Data (Prismatic) Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
161.00	625	0	0
162.00	841	733	733
163.00	1,089	965	1,698
164.00	1,369	1,229	2,927

Device	Routing	Invert	Outlet Devices
#1	Primary	161.00'	4.0" Round Culvert L= 20.0' CPP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 161.00' / 160.60' S= 0.0200 '/' Cc= 0.900 n= 0.012 Corrugated PP, smooth interior, Flow Area= 0.09 sf

Primary OutFlow Max=0.55 cfs @ 0.50 hrs HW=163.25' (Free Discharge)
 1=Culvert (Barrel Controls 0.55 cfs @ 6.26 fps)

PREPARED BY JRM	DATE PREPARED 01/2025	LBM Engineering, LLC 11 HALLY LANE COLCHESTER, CONNECTICUT 06415 TEL: (860)-416-9809 EMAIL: JOHN@LBMENGINEERING.COM	JOB NUMBER	PAGE NUMBER
CHECKED BY	DATE CHECKED		CLIENT NAME	TOTAL PAGES

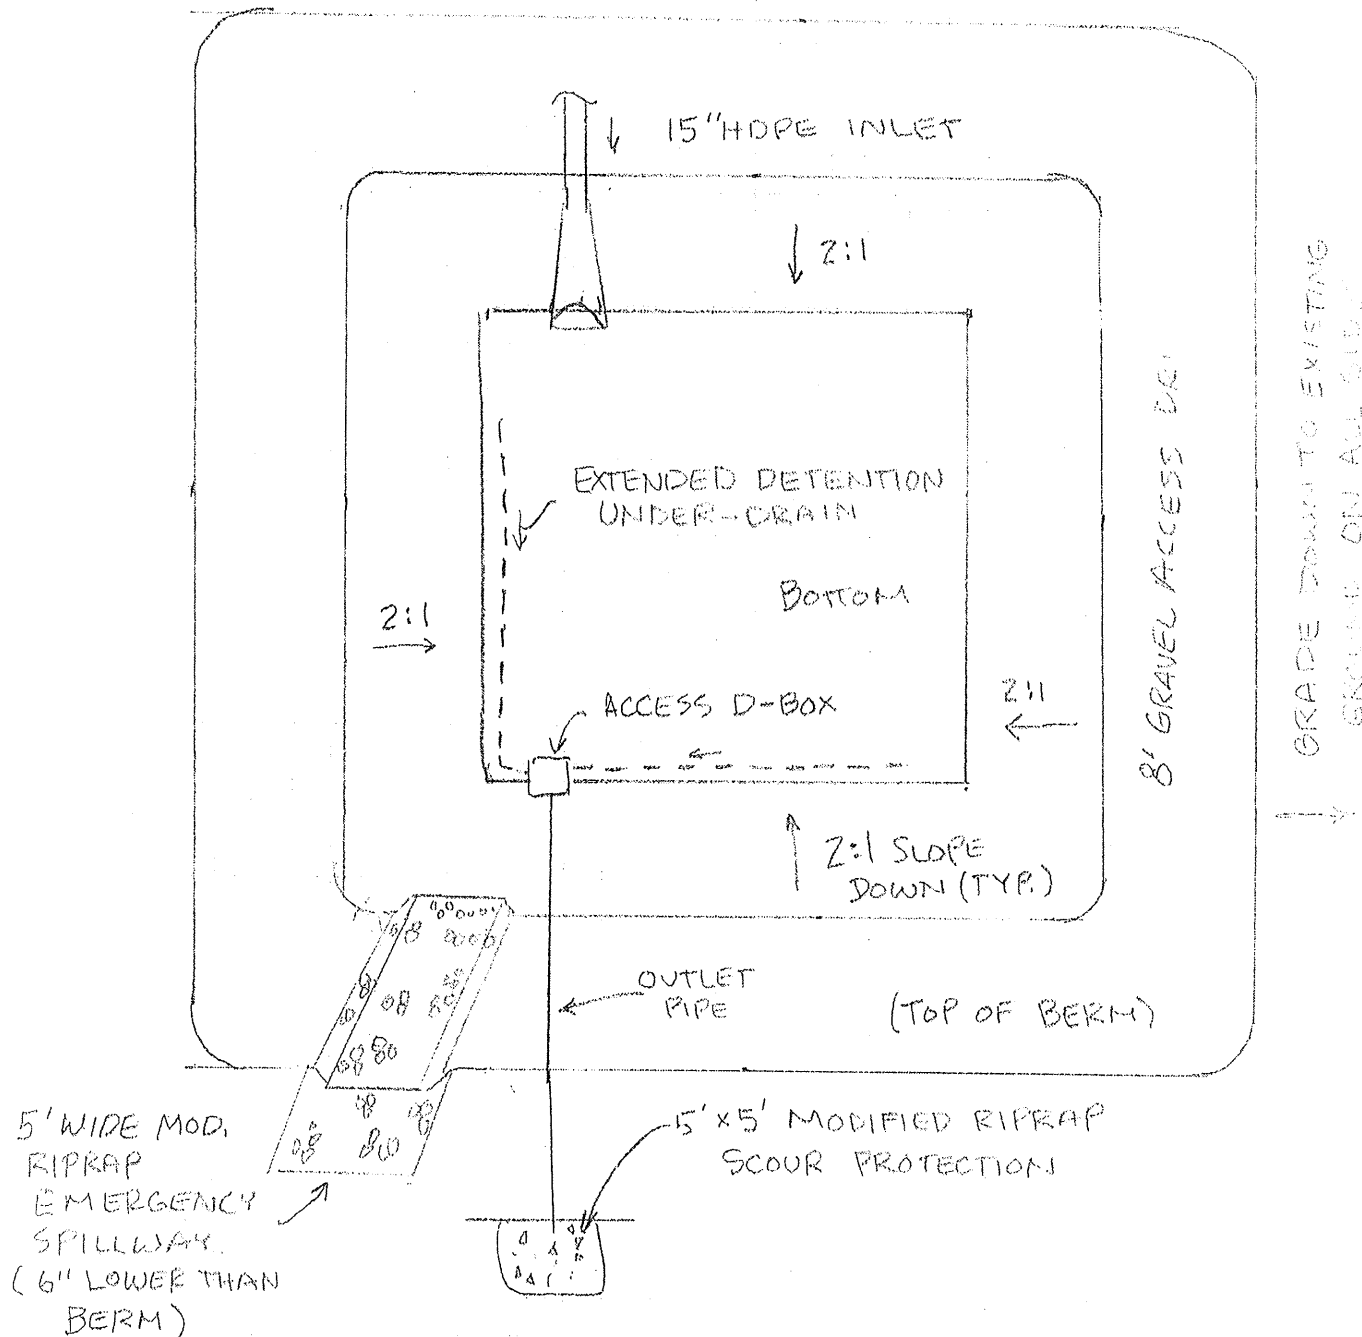

DETAIL DETENTION / WATER QUALITY BASIN
(NOT TO SCALE)